


# E34 - Return to service and disinfection of wells

20 March 2012

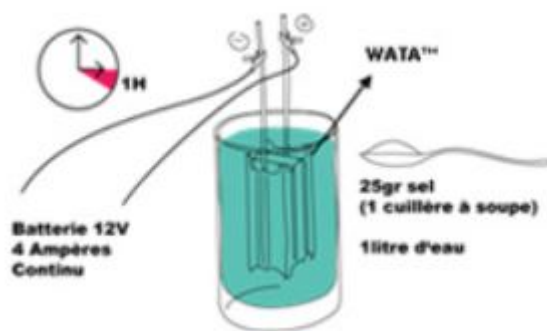

## 1) What is involved ?

It is essential to clean and disinfect contaminated wells following pollution caused by human activities or by a natural disaster (hurricane, flooding, earth tremor, tsunami, etc.) so that they can produce good water quality once again.

## 2) Who use this means and since when ?

All players are potentially involved :

- Well and borehole builders
- People in charge of operation and maintenance
- Well and borehole users
- Emergency teams operating in emergencies or natural disasters

## 3) Why ?

A well or borehole can be contaminated by poor construction, lack of servicing or repairs to the engineered structure, a natural disaster (flooding, earth tremor, tsunami) or environmental pollution.

It is therefore necessary to clean and disinfect the well before it can return to service.

## 4) Who is primarily concerned ?

**All types of wells and boreholes are affected**, especially dug wells in isolated rural areas.

Boreholes are better protected as they open less on the surface which restricts the risk of contamination.

## 5) What does this process involve ? How is it applied ?

**Various stages** must be adhered to for an effective, long-lasting intervention.

### a) Inventory of wells

If a large number of wells is likely to be contaminated, an inventory must be performed to select those to be cleaned and rehabilitated in priority through the following actions :

- Interviews with those people in charge in the community to identify the most frequently used wells
- Identification of contamination sources

- Assessment of the nature and extent of damages on the top and liners of wells
- Estimation of the volume of sludge and debris inside wells
- Pump tests (where fitted) check they are working and to identify necessary repairs
- Estimation of repair resources (personnel, equipment, materials and timescales)
- Selection of wells that are the most used and the easiest to repair

## b) Well cleaning and rehabilitation



A well must be cleaned before it is disinfected to eliminate the source of contamination and carry out essential repairs.

The following actions must be carried out, if required :

- Repairing or changing the pump or the sump system
- Extracting the polluted water and debris from the well (using buckets or pumps)
- Repairing the well walls to reduce the underground pollution
- Cleaning the well liner with chlorinated water
- Sealing the top of the wells by installing a clay-based sanitary seal all around the well
- Constructing a draining area around the well to prevent the surface water, insects and rodents from entering the well

**Once the well has been cleaned and rehabilitated**, its inside water level must be allowed to return to its normal level and the **turbidity and pH must be measured** to ensure that the chlorination has been effective. If the water is cloudy, no more chlorine should be added to the water as the suspended particles protect the micro-organisms and therefore reduce the effect of chlorination. The turbidity is measured in NTU (Nephelometric Turbidity Unit).

If the turbidity of the well water is more than 5 NTU after cleaning and rehabilitation work, the well must be emptied of water one more time and the internal well liner must be cleaned with a fairly strong solution of bleach. Let the well fill once again and re-check the turbidity to make sure that it is normal.

The following table gives the WHO recommended pH and turbidity levels :

### Physico-chemical parameters

Parameter	WHO recommendation	Why	Corrective action
pH	6 - 8	A pH of 6.8 - 7.2 is required to reduce the chlorine level	if the pH is lower than 6, add hydrated lime
Turbidity	< 5 NTU (20 NTU critical threshold)	High turbidity requires more chlorine to oxidise the organic substances	Empty the well and clean it with bleach

There are **various ways** to perform turbidity and pH analyses :

- Analysis kits
- Mobile analysers
- Reactive bandelets



For more detailed information, see sheet **E27 "Methods and available means, either simple or more elaborate, for the physical, chemical and/or bacteriological analysis of the water."**

**If you have no way of measuring the turbidity**, you can use the approximate method below suggested by WHO in the event of an emergency :


- Take a large clean bucket or bin, with a fairly dark inside colour and at least 50 cm deep.
- Drop in a coin or 2 or 3 cm, pour in the water to be analysed and stir.
- Leave it to settle.
- Is the coin visible ?

If yes, this means that the NTU is less than 10.

If not, measure the approximate height of the water that is transparent.

- If this is less than 32 cm, the NTU is probably greater than 20. Filter the water and measure again.
- If this is between 32 and 50 cm, the NTU is probably between 10 et 20. It is advisable to filter the water.

### c) Disinfecting wells

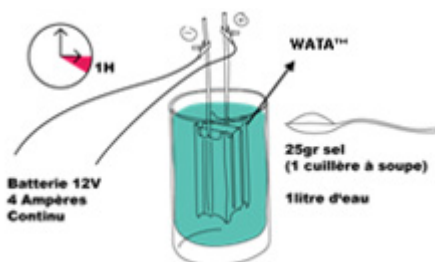

#### Local chlorine manufacture.

##### Antenna process. See sheet E18

**WHO stipulates full disinfection of the water** as soon as there is a risk of pollution and in emergency situations. There are a **variety of ways** of doing this, but the **most common is chlorination** which has the advantage of leaving a residual disinfectant in the water after the disinfection treatment.

Chlorine also has the advantage of being widely available, simple to dose and use and dissolves easily in water. Conversely, it is a hazardous product that has to be stored and handled with care. Small doses have no effect on pathogenic organisms such as cysts and viruses which required strong concentrations of chlorine.

The chlorine product most used is calcium hypochlorite (HTH or high test hypochlorite) in powder or granule form, with a concentration of 50 to 70% of chlorine for emergencies. Powdered or liquid sodium hypochlorite can also be used.

The amount of chlorine required depends on the volume of water in the well. One litre of chlorinated solution at 0.2% per 100 litres of well water must be incorporated.

The well water must be mixed carefully with the chlorinated solution and settle for at least half an hour.

The volume of chlorinated solution must be calculated from the design parameters of the well according to the method shown in the insert below.

## Calculation of the chlorine dose to disinfect a well using calcium hypochlorite (HTH)

### Equipment :

20 litre bucket

Calcium hypochlorite powder or granules

### Method :

Calculate the volume of water in the well using the formula

$$V = (\pi D^2 / 4) \times h$$

V = volume of water in the well (m<sup>3</sup>)

D = well diameter (m)

h = water depth (m)

$\pi = 3.142$

Fill the bucket with clean water

Add 50 g calcium hypochlorite and mix until dissolved

For each m<sup>3</sup> of water in the well, add 10 litres of chlorinated solution.

## d) Emptying wells

After the period in contact with the chlorinated solution, it is important to **empty the well** with a pump or bucket and leave the well to refill. When the well is full once more, wait about half an hour and measure the residual chlorine concentration. The well can be used if this concentration is less than 0.5 mg/l. Otherwise, the well must be emptied of water again and the operation restarted.



## 6) Special difficulties and remedies

It is absolutely essential to **ban the use of the well during the cleaning/disinfecting phase**, as the water is very highly chlorinated which tastes nasty with a strong smell and could be dangerous to use.

## 7) Main advantages and drawbacks

It is normally cheaper to disinfect and return a well to service than to build a new well. However, if the well has been severely damaged, a return to service can prove complex and costly. In this case the damaged well should be abandoned and a new one built.

## 8) Cost

The cost of returning a well to service can **vary according to the type of well and the damage to it**. It is therefore difficult to give an accurate estimation.

## 9) Precisions about bored wells

Bored wells are **protected better due to the smaller opening on the surface** which limits the risk of contamination. They can however be contaminated by leaks in neighbouring septic tanks, drains or damaged industrial facilities causing infiltrations into the ground.

Overall, the same general method is used to return them to service as for the dug wells.

The only **specific feature** : the inside of the bored well (removal of sludge or waste) can be **cleaned by injected pressurised water** using a hose inserted in the well. The sludge and the waste suspended in the injected water are evacuated to the surface as the bored well fills up. Pressurised water continues to be

injected until the water evacuated to the surface runs clear.



## 10) Where to obtain further information

### a) Internet sites



- **French Red Cross Management, cleaning and sanitation of wells in a disaster**

<http://medecinetropicale.free.fr/co...>

- **WHO and WEDC sites**

A series of **very interesting illustrated sheets on emergencies** (in English only) have been produced by **WHO** and **WEDC** (*Water, Engineering and Development Centre*) located at the University of Loughborough in Great Britain.

The following **sheets stand out** - their direct access links are given :

- **WHO/WEDC : "Cleaning and disinfecting wells"**

[http://www.who.int/water\\_sanitation...](http://www.who.int/water_sanitation...)

- **WHO/WEDC : "Cleaning and disinfecting boreholes"**

[http://www.who.int/water\\_sanitation...](http://www.who.int/water_sanitation...)

- **WEDC : "Cleaning and disinfecting boreholes"**

<http://wedc.lboro.ac.uk/knowledge/w...>

### b) Videos

**"Cleaning and disinfecting wells"**, 40' video showing how the wells were cleaned and disinfected in Pakistan following the serious flooding in 2010. Available online at :

<http://www.youtube.com/watch?v=Fb5g...>

**"Emergency well disinfection"**, 9' video on disinfecting an individual well after contamination. Available online at :

<http://www.youtube.com/watch?v=uZLR...>

- Emplacement : Accueil > en > Wikiwater > Technical sheet > Facilitating access to water > Distributing >
- Adresse de cet article : <https://wikiwater.fr/e34-methods-of-restarting-and>